



PROFILE OF INNOVATION



Schlüter[®]-DITRA-HEAT-E

Undertile and stone heating with Schlüter[®]-DITRA technology

Installation Guide




Installation Helpline: 01530 813396





Schlüter®-DITRA-HEAT-E

Schlüter®-DITRA-HEAT-E is an undertile and stone heating system for floors and walls that quickly creates comfortably warm floors and walls. The heating cables of Schlüter®-DITRA-HEAT-E are installed in the uncoupling mat corresponding to areas that are to be heated. Due to the flexible control of temperatures and heating times provided by Schlüter's digital and Wi-Fi thermostats, you can use Schlüter®-DITRA-HEAT-E to create warmth whenever and wherever you choose.

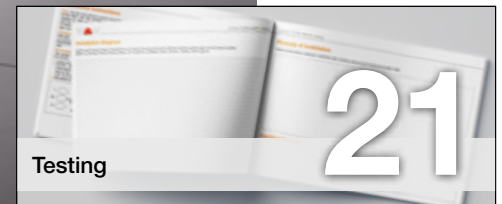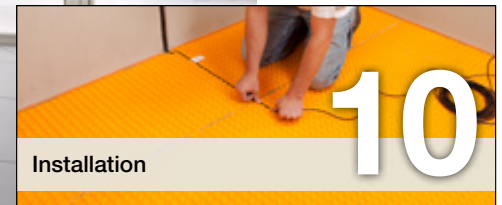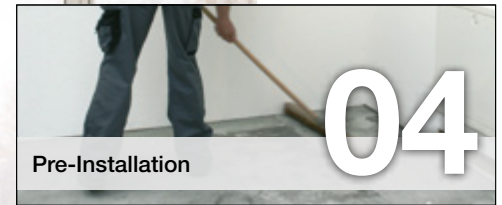



Schlüter®-DITRA-HEAT-E-CT

Schlüter®-DITRA-HEAT-E-CT is a test device for measuring and checking the resistance of the electrical heating cables Schlüter®-DITRA-HEAT-E-HK and the remote sensors supplied with Schlüter®-DITRA-HEAT-E thermostats. The device monitors the resistance of the heating cables during the entire installation phase and alerts the installer with an acoustic signal in the event of damage.

(Product data sheet 6.4)



Schlüter®-DITRA-HEAT-E-ZS

Schlüter®-DITRA-HEAT-E-ZS is an installation set comprising a conduit (2.5 m), junction box, and sensor sleeve. It can be used if the installation of the remote sensor in the conduit is preferred.

(Product data sheet 6.4)



Schlüter®-KERDI-BOARD

Schlüter®-KERDI-BOARD is a universal substrate for the installation of tile and stone on walls and floors. Schlüter®-KERDI-BOARD provides additional insulation beneath the electrical heating assembly, when installed with Schlüter®-DITRA-HEAT/-MA mats and rolls. Schlüter®-KERDI-BOARD can be installed on walls beneath Schlüter®-DITRA-HEAT-DUO/-MA.

(Product data sheet 12.1)



Schlüter®-DITRA-SOUND-RSK

Schlüter®-DITRA-SOUND-RSK is an edge insulation strip for around the perimeter of the room to reduce sound transfer through walls.

(Product data sheet 6.3)





Before installing Schlüter®-DITRA-HEAT-E the following should be observed



Substrates for Schlüter®-DITRA-HEAT/-DUO

Always check the substrates on which Schlüter®-DITRA-HEAT and -DUO are to be installed to make sure they are even, rigid, load-bearing, clean and compatible with the materials to be used. Remove all surface components that may weaken the bond. Uneven or sloped areas must be levelled prior to the installation of Schlüter®-DITRA-HEAT/-DUO.

Concrete: Concrete is subject to long-term form changes due to curing processes. Additional tensions may result from the deflection of concrete and pre-stressed concrete. Schlüter®-DITRA-HEAT uncouples the tensions between concrete and tile covering, which means that tiles can be installed as soon as the concrete reaches a sufficient level of stability. On walls, allow at least 6 weeks drying time prior to fixing Schlüter®-DITRA-HEAT/-DUO mat, ensuring the background is stable, clean and rigid and that it is free from any barriers to adhesion, e.g. plaster droppings, grease, etc. Surfaces to be tiled must be flat and when checked with a 2 metre straight edge, any gap under the straight edge between points of contact with the surface should not exceed 3 mm. Minor irregularities should be pre-smoothed prior to fixing the mat.



Cementitious screeds: With Schlüter®-DITRA-HEAT/-DUO, tile and stone can be installed on green cementitious screeds as soon as they are ready to bear weight (please note that additional drying time may be required for screed depths over 40 mm). In accordance with the applicable regulations, cementitious screeds must be at least 28 days old and have a residual moisture level below 2 CM% before tiles can be installed. However, floating screeds and heated screeds are particularly prone to curling and cracking, often because of weight loads and temperature fluctuations.

Calcium sulfate screeds: According to the applicable regulations, calcium sulfate screeds (anhydrite screeds) must have a residual moisture level below 0.5 CM% before tiles can be installed. When Schlüter®-DITRA-HEAT/-DUO is used, the tile covering is ready to be installed as soon as the residual moisture level drops below 2 CM%. If necessary, treat the screed surface in accordance with the codes of practice and manufacturer instructions (sanding, priming). Schlüter®-DITRA-HEAT/-DUO can be installed with dry-set adhesives or other suitable thin-bed adhesives. Schlüter®-DITRA-HEAT/-DUO protects the screed against the penetration of moisture at the surface. Calcium sulfate screeds are sensitive to moisture, making it necessary to protect the screed from further moisture.



Heated screeds: Schlüter®-DITRA-HEAT may also be installed over heated screeds, with the above material notes to be observed (cement, calcium sulfate). When Schlüter®-DITRA-HEAT is used, the covering assembly may be heated up as early as 7 days after completion. Starting from 25 °C, increase the supply temperature by a maximum of 5 °C a day to reach an operating temperature of max. 40 °C.

Note: The use of Schlüter®-DITRA-HEAT over heated screeds allows for individual, partial heating that is separate from the central heating system. This makes it feasible to switch off the central heating system during seasonal transition periods. Furthermore, Schlüter®-DITRA-HEAT can help cover peak loads. Schlüter®-DITRA-HEAT-DUO is not advised as the integrated thermal break will inhibit the heat transfer from the screed.



Synthetic coverings and coatings: All surfaces must be weight-bearing and, if necessary, pre-treated, to allow for the bonding of a suitable adhesive for permanent attachment of the bonding fleece of Schlüter®-DITRA-HEAT/-DUO. The suitability of the adhesive for the substrate and for Schlüter®-DITRA-HEAT/-DUO must be verified in advance.

Plywood panels: These materials are heavily affected by moisture (or large fluctuations in humidity). It is therefore recommended to use plywood materials with special impregnation to prevent the absorption of moisture (e.g. external grade plywood). Where available refer to the codes of practice relevant to each country regarding the selection of products and the construction methods. In principle, panels can be used as a substrate on walls and floors in interior areas. The thickness of the panels should be selected to ensure sufficient impact resistance in conjunction with a suitable support structure. The panels must be sufficiently secured with closely spaced screw fixings. All board joints should be fully supported by joists or additional supports (noggins). Additional supports may prove necessary to provide a rigid and stable substrate. Edge joints of approx. 10 mm must be kept open at the connections with adjoining construction parts. Schlüter®-DITRA-HEAT/-DUO neutralises the stresses in the tile or stone covering and also prevents the penetration of moisture.

Hardwood floors: The direct installation of ceramic coverings over hardwood floors is generally feasible, provided the floorboards have tongue and groove connections, are sufficiently load bearing, and are tightly screwed down. The wooden substrate should have reached a balanced moisture level prior to the installation of Schlüter®-DITRA-HEAT/-DUO. Experts recommend the installation of an additional layer of plywood. Uneven floors must be levelled before the installation of other materials.


Tiling to cement/sand render: Finish the surface with a wood float and prevent the surface from rapid drying for 1–2 days. Allow to air dry for at least two weeks prior to installing the Schlüter®-DITRA-HEAT/-DUO mat. Surface regularity is as per concrete.

Tiling to plasterboard: Ensure boards are rigidly braced and adequately supported; DO NOT skim plaster, adhere Schlüter®-DITRA-HEAT/-DUO directly to the paper face. Maximum weight of tiling and assembly should not exceed 32 kg per square metre.

Gypsum plaster: Gypsum plaster must be dry and at least 4 weeks old, do not use in wet or damp conditions. Brush down the surface prior to fixing Schlüter®-DITRA-HEAT/-DUO and prime surface as instructed by the adhesive supplier. The maximum weight of tiling and assembly should not exceed 20 kg per square metre.

Concrete blockwork and brickwork: Allow 6 weeks drying time before direct fixing or rendering. Surface regularity is as per concrete.

Schlüter®-KERDI-BOARD: Over un-insulated concrete and timber subfloors, Schlüter®-KERDI-BOARD can be used below the Schlüter®-DITRA-HEAT/-MA membrane to reduce heat up time and efficiency, but cannot be used below Schlüter®-DITRA-HEAT-DUO/-MA. Where Schlüter®-KERDI-BOARD is being used as the wall substrate, then both Schlüter®-DITRA-HEAT/-MA and Schlüter®-DITRA-HEAT-DUO/-MA can be used.

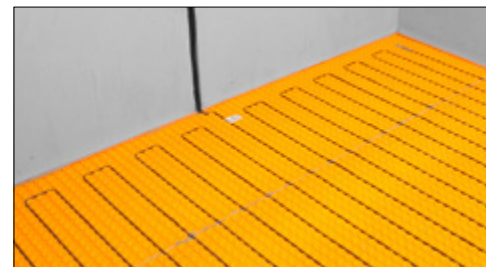



Pre-installation planning for floors

For common floor sizes we offer a number of complete kits which include all the required matting (Schlüter®-DITRA-HEAT-DUO-MA or Schlüter®-DITRA-HEAT-MA), heating cable (Schlüter®-DITRA-HEAT-E-HK) and thermostat (See table below for included thermostat).

Schlüter®-DITRA-HEAT-E-DUO-S Floor Kits

complete electrical floor heating system with integrated thermal break, includes Schlüter®-DITRA-HEAT-E-R-WIFI smart thermostat.

Uncoupled area (m ²)	Heated area (m ²) at 136 W/m ²	Art.-No.
1.6	1.1	DH D RT5 S1
2.4	1.6	DH D RT5 S2
3.2	2.2	DH D RT5 S3
4.0	2.7	DH D RT5 S4
4.8	3.3	DH D RT5 S5
5.6	3.8	DH D RT5 S6
6.4	4.4	DH D RT5 S7
7.2	5.0	DH D RT5 S8
8.0	5.5	DH D RT5 S9

Schlüter®-DITRA-HEAT-E-S Floor Kits

complete electrical floor heating system, Schlüter®-DITRA-HEAT-E-R digital thermostat.

Uncoupled area (m ²)	Heated area (m ²) at 136 W/m ²	Art.-No.
5.6	3.8	DH S1
8.0	5.5	DH S2
3.2	2.2	DH S3

For other floor sizes the below steps and tables can be used as a guide to create a bill of materials.

Step 1: Draw floor area onto graph paper removing unheated areas, e.g. bath, shower, sink, toilet and kitchen units etc.

Step 2: Calculate heating area with unheated areas removed from calculation.

Step 3: Choose heating area from heating cable chart below. The heating cable must be calculated and installed for 136 W/m² (3 studs) and allow 2 studs (60 mm) from all walls and building elements, e.g. bath, toilet bowl etc.

Step 4: Choose total floor area from the uncoupling chart (Schlüter®-DITRA-HEAT-DUO or Schlüter®-DITRA-HEAT) and ensure enough uncoupling mat is purchased to cover the whole floor area.

Step 5: Select a thermostat from Schlüter®-DITRA-HEAT-E-R-WIFI (Smart thermostat, Art.-No. DH E RT5), Schlüter®-DITRA-HEAT-E-R (Digital thermostat, Art.-No. DH E RT2/BW), Schlüter®-DITRA-HEAT-E-R3 (Feature thermostat, Art.-No. DH E RT3/BW) or Schlüter®-DITRA-HEAT-E-R4 (Analogue thermostat, Art.-No. DH E RT4/BW)



Schlüter®-DITRA-HEAT-DUO	
uncoupling matting required	
Total floor area (m ²)	Art.-No.
< 0.90	DHD8MA
< 0.90	DHD8MA
0.90 – 1.60	DHD8MA
1.70 – 2.40	DHD8MA
2.50 – 3.20	DHD8MA
3.30 – 4.00	DHD8MA
4.10 – 4.80	DHD8MA
4.90 – 5.60	DHD8MA
5.70 – 6.40	DHD8MA
6.50 – 7.20	DHD8MA
7.30 – 8.00	DHD8MA
8.10 – 8.80	DHD810M
8.90 – 9.60	DHD810M
9.70 – 10.40	DHD810M + DHD8MA
10.50 – 11.20	DHD810M + DHD8MA
11.30 – 13.60	DHD810M + DHD8MA
13.70 – 15.20	DHD810M + DHD8MA
15.30 – 18.40	DHD810M + DHD8MA
18.50 – 22.00	DHD810M + DHD8MA
22.10 – 24.00	DHD810M + DHD8MA

Schlüter®-DITRA-HEAT	
uncoupling matting required	
Total floor area (m ²)	Art.-No.
< 0.90	DH5 MA
< 0.90	DH5 MA
0.90 – 1.60	DH5 MA
1.70 – 2.40	DH5 MA
2.50 – 3.20	DH5 MA
3.30 – 4.00	DH5 MA
4.10 – 4.80	DH5 MA
4.90 – 5.60	DH5 MA
5.70 – 6.40	DH5 MA
6.50 – 7.20	DH5 MA
7.30 – 8.00	DH5 MA
8.10 – 8.80	DH5 MA
8.90 – 9.60	DH5 MA
9.70 – 10.40	DH5 12M
10.50 – 11.20	DH5 12M
11.30 – 13.60	DH5 12M + DH5 MA
13.70 – 15.20	DH5 12M + DH5 MA
15.30 – 18.40	DH5 12M + DH5 MA
18.50 – 22.00	DH5 12M + DH5 MA
22.10 – 24.00	DH5 12M + DH5 12M

Schlüter®-DITRA-HEAT-E-HK	
heating cable required at 136 W/m ²	
Heated area (m ²) at 136 W/m ²	Art.-No.
0.4	DH E HK 4
0.8	DH E HK 6
1.1	DH E HK 12
1.6	DH E HK 17
2.2	DH E HK 23
2.7	DH E HK 29
3.3	DH E HK 35
3.8	DH E HK 41
4.4	DH E HK 47
5.0	DH E HK 53
5.5	DH E HK 59
6.6	DH E HK 71
7.7	DH E HK 83
8.8	DH E HK 95
10.0	DH E HK 107
12.7	DH E HK 136
15.0	DH E HK 164
17.7	DH E HK 192
20.0	DH E HK 216
22.7	DH E HK 244

Note: Full drawings should be created and requirements calculated before selecting the products. For larger areas add the areas together to calculate the requirements. The above charts should be used as a guide only.



Pre-installation planning for walls

For common wall sizes we offer a number of complete kits which include all the required matting (Schlüter®-DITRA-HEAT-DUO-MA or Schlüter®-DITRA-HEAT-MA), heating cable (Schlüter®-DITRA-HEAT-E-HK) and thermostat (Schlüter®-DITRA-HEAT-E-R, Art.-No. DH E RT2/BW) elements.

Schlüter®-DITRA-HEAT-E-DUO-WS Wall Kits			
complete electrical wall heating system with integrated thermal break			
Uncoupled area (m ²)	Heated area (m ²) at 136 W/m ²	Heated area (m ²) at 200 W/m ²	Art.-No.
3.2	3.8	2.6	DH D S10
2.4	2.7	1.8	DH D S11

Schlüter®-DITRA-HEAT-E-WS Wall Kits			
complete electrical wall heating system			
Uncoupled area (m ²)	Heated area (m ²) at 136 W/m ²	Heated area (m ²) at 200 W/m ²	Art.-No.
3.2	3.8	2.6	DH WS1
2.4	2.7	1.8	DH WS2

For other floor sizes areas the below steps and tables can be used as a guide to create a bill of materials.

Step 1: Draw wall area onto graph paper removing unheated areas, e.g. mirrors, wall units etc.

Step 2: Calculate heating area with unheated areas removed from calculation.

Step 3: Choose heating area from heating cable chart below, determining whether the output needs to be 200 W/m² (2 studs) or 136 W/m² (3 studs). The heating cable must be installed 2 studs (60 mm) from all walls and building elements, e.g. door frame, shower screen, windows.

Step 4: Choose total wall area from the uncoupling chart (Schlüter®-DITRA-HEAT-DUO-MA or Schlüter®-DITRA-HEAT-MA) and ensure enough uncoupling mat is purchased to cover the whole area to be heated. The matting variants (-MA) are advised for wall installations.

Step 5: Select the touchscreen digital thermostat Schlüter®-DITRA-HEAT-E-R (Art.-No. DH E RT2/BW (included in the kits)), Schlüter®-DITRA-HEAT-E-R3 (Art.-No. DH E RT3/BW) or Schlüter®-DITRA-HEAT-E-R4 (Art.-No. DH E RT4/BW).




Schlüter®-DITRA-HEAT-DUO-MA	
uncoupling matting required	
Total wall area (m ²)	Art.-No.
< 0.90	DHD8MA
< 0.90	DHD8MA
0.90 – 1.60	DHD8MA
1.70 – 2.40	DHD8MA
2.50 – 3.20	DHD8MA
3.30 – 4.00	DHD8MA
4.10 – 4.80	DHD8MA
4.90 – 5.60	DHD8MA
5.70 – 6.40	DHD8MA
6.50 – 7.20	DHD8MA
7.30 – 8.00	DHD8MA
8.10 – 8.80	DHD8MA
8.90 – 9.60	DHD8MA
9.70 – 10.40	DHD8MA
10.50 – 11.20	DHD8MA
11.30 – 13.60	DHD8MA
13.70 – 15.20	DHD8MA
15.30 – 18.40	DHD8MA
18.50 – 22.00	DHD8MA
22.10 – 24.00	DHD8MA

Schlüter®-DITRA-HEAT-MA	
uncoupling matting required	
Total wall area (m ²)	Art.-No.
< 0.90	DH5 MA
< 0.90	DH5 MA
0.90 – 1.60	DH5 MA
1.70 – 2.40	DH5 MA
2.50 – 3.20	DH5 MA
3.30 – 4.00	DH5 MA
4.10 – 4.80	DH5 MA
4.90 – 5.60	DH5 MA
5.70 – 6.40	DH5 MA
6.50 – 7.20	DH5 MA
7.30 – 8.00	DH5 MA
8.10 – 8.80	DH5 MA
8.90 – 9.60	DH5 MA
9.70 – 10.40	DH5 MA
10.50 – 11.20	DH5 MA
11.30 – 13.60	DH5 MA
13.70 – 15.20	DH5 MA
15.30 – 18.40	DH5 MA
18.50 – 22.00	DH5 MA
22.10 – 24.00	DH5 MA

Schlüter®-DITRA-HEAT-E-HK		
heating cable required		
Heated area (m ²) at 136 W/m ²	Heated area (m ²) at 200 W/m ²	Art.-No.
0.4	0.25	DH E HK 4
0.6	0.43	DH E HK 6
1.1	0.7	DH E HK 12
1.6	1.0	DH E HK 17
2.2	1.5	DH E HK 23
2.7	1.8	DH E HK 29
3.3	2.2	DH E HK 35
3.8	2.6	DH E HK 41
4.4	2.9	DH E HK 47
5.0	3.3	DH E HK 53
5.5	3.7	DH E HK 59
6.6	4.4	DH E HK 71
7.7	5.1	DH E HK 83
8.8	5.9	DH E HK 95
10.0	6.6	DH E HK 107
12.7	8.4	DH E HK 136
15.0	10.0	DH E HK 164
17.7	11.8	DH E HK 192
20.0	13.2	DH E HK 216
22.7	15.1	DH E HK 244

Note: Full drawings should be created and requirements calculated before selecting the products. For larger areas add the areas together to calculate the requirements. The above charts should be used as a guide only.

Installation instructions

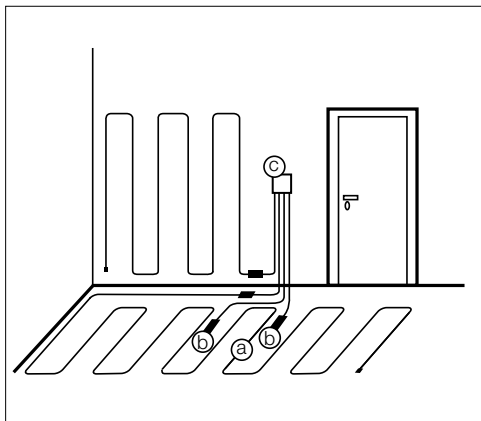

Sensor and thermostat position

- a) Schlüter®-DITRA-HEAT heating cable
- b) Sensor installed within the uncoupling membrane
- c) Digital thermostat

Please note: When installing Schlüter®-DITRA-HEAT-E in wet environments such as bathrooms and wetrooms the placement of the thermostat needs to be in line with UK regulations for 230v supply e.g. outside of zone 0, 1 and 2.

Positioning the sensor: The sensors are installed directly in the newly installed uncoupling membrane Schlüter®-DITRA-HEAT. The sensor should be placed in the floor between two heating cables (see image), while ensuring the sensor is not placed next to the cold leg of the heating cable - see heating cable label for hot and cold side.

⚠ Both sensors should be installed, one connected to the thermostat the second sensor as a spare positioned behind the thermostat for future connection.

Matting installation

Cut sections of Schlüter®-DITRA-HEAT/-DUO to size and fully embed the anchoring fleece into the adhesive using a 6 x 6 mm notched trowel. Immediately press the material into the adhesive with a float or roller. Work in a single direction, and observe the curing times of all materials. When installing rolled materials, it is best to align the studs of the Schlüter®-DITRA-HEAT/-DUO with light tension at the time of embedding the material. The individual membranes should be aligned next to each other with the stud structure lined up.

Important: Testing of the heating cable, must be carried out prior to installation, and again after installation of the heating cable and before tile/stone floor finish is installed. To test the resistance of the heating cable use the Schlüter®-DITRA-HEAT-CT cable tester with inbuilt alarm. Ohm figures for each cable length and (Art. No.), please see page 15.

Floors: To prevent damage or detachment from the substrate, it is recommended to use walking boards (especially in the centre of the assembly) to protect the installed Schlüter®-DITRA-HEAT/-DUO membrane from mechanical impact.

The heating cables can be installed immediately after adhering the uncoupling membrane Schlüter®-DITRA-HEAT/-DUO; the heating cable should be installed and pressed into position using a float. We recommend that a groove is prepared in a stud of the Schlüter®-DITRA-HEAT/-DUO membrane to position the heating cable end.

Walls: It is recommended to adhere the Schlüter®-DITRA-HEAT-MA/-DUO-MA mat to the wall with suitable tile adhesive and allow to set. Installation of the heating cable can begin once resistance has been checked and the matting is bonded to the substrate. Once the cable is secured and dependent on the tile or stone covering it may be necessary to in-fill the top of the mat with tile adhesive and allow to set, then comb out adhesive and install tiles.





Heating cable installation

Floors: The stud spacing of the uncoupling membrane is 3 cm. Heating cables should be installed with a distance of 9 cm (every third stud); closer spacing is not permissible. We also advise that the heating cable should be no closer than 60 mm (2 studs) from any building element, e.g. wall, column, bath, toilet, etc. The heating cable should not cross.

Walls: The stud spacing of the uncoupling membrane is 3 cm. Heating cables should be installed with a distance of 6 cm (every second stud) or 9 cm (every third stud); closer spacing is not permissible. We also advise that the heating cable should be no closer than 60 mm (2 studs) from any building element, e.g. wall, column, bath, toilet, etc. The heating cable should not cross.

Heating cable test:

The transition from the heating side to the cold connection cable (sleeve) is labelled as shown the transition must be installed straight within the matting (not installed curved around a stud). This cold side of the heating cable is 4 metres in length and can be connected directly to the thermostat or junction box. The minimum cut length is 1 metre from the label on the cold side.





Important: Testing of the heating cable, must be carried out prior to installation, and again after installation of the heating cable and before tile/stone floor finish is installed. To test the resistance of the heating cable use the Schlüter®-DITRA-HEATE-CT cable tester with inbuilt alarm. Ohm figures for each cable length and (Art. No.), please see page 15.

Note: Device will switch off after 60 minutes when not in use.

We recommend an insulation test is carried out prior to the embedding of the heating cables to measure the resistance of the heating cables and that the results are entered into the enclosed log on page 25.

Once the heating cables have been installed and tested, tiles can be installed in the thin bed method, using a thin bed adhesive that meets the requirements of the tile covering. Use a grout float to fill the grooves of the uncoupling membrane in a single step (heating cables and sleeves must be fully enclosed with tile adhesive) and then use a notched trowel to apply the adhesive. A minimum 5 mm of covering (adhesive and tiles) is required above the heating cable. Please observe the instructions regarding perimeter joints and connection joints in product data sheet 6.4 Schlüter®-DITRA-HEAT.

Important: The assembly should be left for a minimum of 7 days before turning on the electrical heating system.

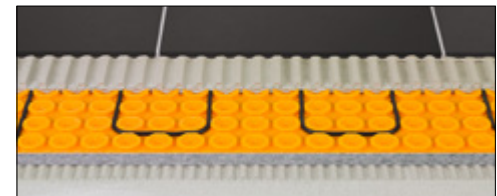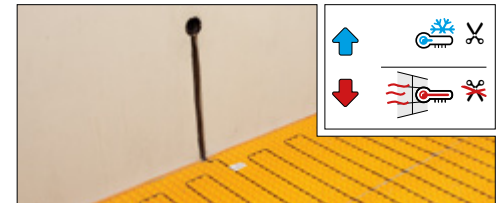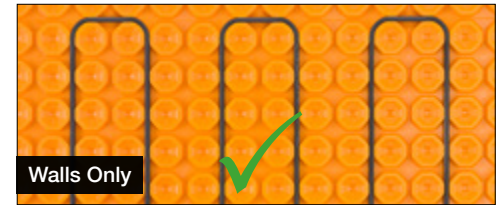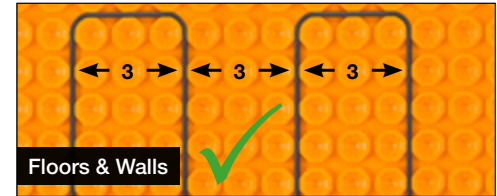




Example installations


En-suite bathroom 2 x 2.5 m

5 m² uncoupled floor area,
3.8 m² of heated floor space,
sensors positioned in the floor equally
between 2 heating cables,
thermostat positioned outside the
room.

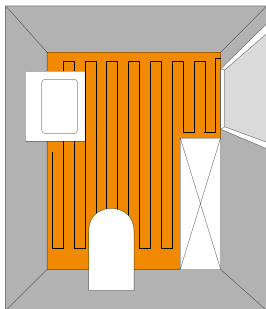


Bathroom 2 x 4 m

8 m² of uncoupled floor space,
5.5 m² of heated space,
sensors positioned in the floor equally
between 2 heating cables,
thermostat positioned outside the
room.

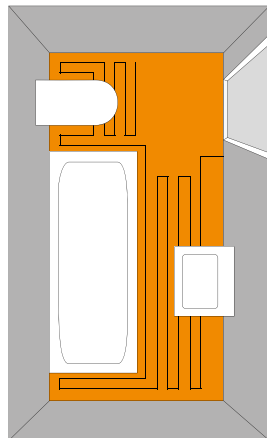


Hallway 3 x 5.6 m

16.8 m² of uncoupled floor space,
3.8 m² of heated space in front of
entrance,
sensors positioned in the floor equally
between 2 heating cables, thermostat
positioned outside the room.

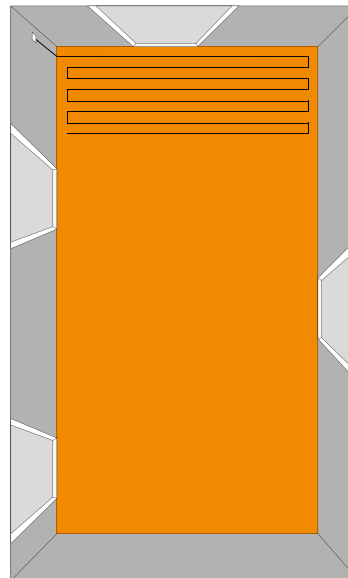

Bathroom Wall Application


3.2 m² of uncoupled wall area,
2.6 m² of heated surface,
sensors positioned in the wall equally
between 2 heating cables, thermostat
positioned outside the room.

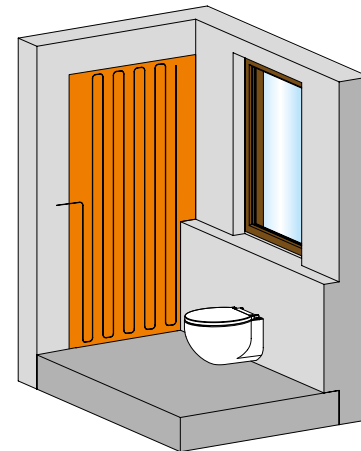

It is recommended that the room area is measured accurately and all unheated areas are taken into consideration when working out cable size required. The heating cable must be sized accurately as only 3 m can be removed from the cold side of the heating cable.



Sample floor assembly

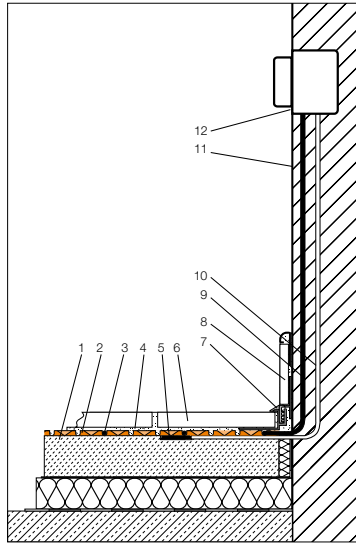


- ① Sub floor
- ② Schlüter®-DITRA-HEAT or Schlüter®-DITRA-HEAT-DUO
- ③ Schlüter®-DITRA-HEAT-HK heating cable
- ④ Temperature resistant thin bed adhesive
- ⑤ Sensors (2 x installed, 1st connected to thermostat, 2nd as redundant back-up)
- ⑥ Tile or Stone
- ⑦ Perimeter movement joint from Schlüter®-DILEX range
- ⑧ Skirting
- ⑨ Heating cable connected to thermostat
- ⑩ Sensor conduit
- ⑪ Wall
- ⑫ Schlüter®-DITRA-HEAT-E-R/-R3/-R4 or /-R-WIFI, in junction box.

Schlüter®-DITRA-HEAT-E-R digital touchscreen thermostat controller allows programmed switching events. Refer to the instruction manual in the thermostats box. The temperature will be controlled according to the temperature measured by the remote sensor. The heater will be switched on when the temperature drops below the current set point.

Note: The Schlüter®-DITRA-HEAT-E-R digital thermostat should be installed with single phase mains supply via RCD with a fused isolator switch fitted. The fuse rating is dependent on the overall loading. Consider switching load of the controller. When installing Schlüter®-DITRA-HEAT-E-R in wet environments such as bathrooms and wetrooms the placement of the thermostat and fused spur need to be in line with UK regulations for 230v supply e.g. outside of zone 0,1 and 2.


Schlüter®-DITRA-HEAT-E-R-WIFI

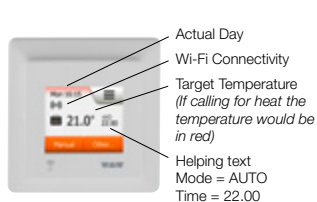


Schlüter®-DITRA-HEAT-E-R3



Schlüter®-DITRA-HEAT-E-R

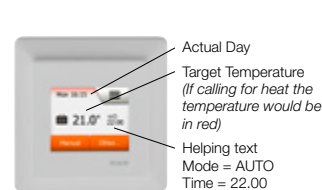

Schlüter®-DITRA-HEAT-E-R4

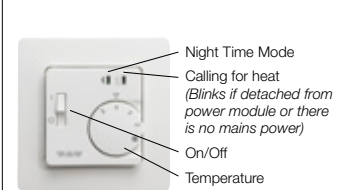





Wiring diagram

The Schlüter®-DITRA-HEAT-E-R/-R3/-R4 and -R-WIFI digital thermostat must be installed by a qualified electrician, according to the relevant wiring diagram indicated and in compliance with all applicable safety regulations. The electrical wiring must conform to BS 7671: "The IEE Wiring Regulations" (latest edition).


Schlüter®-DITRA-HEAT-E-R /-R-WIFI

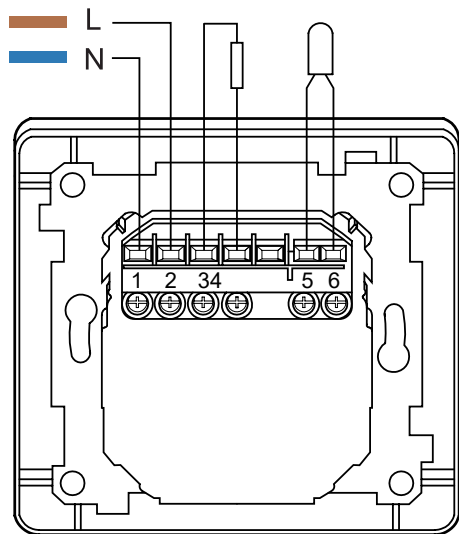

Schlüter®-DITRA-HEAT-E-R /-R3


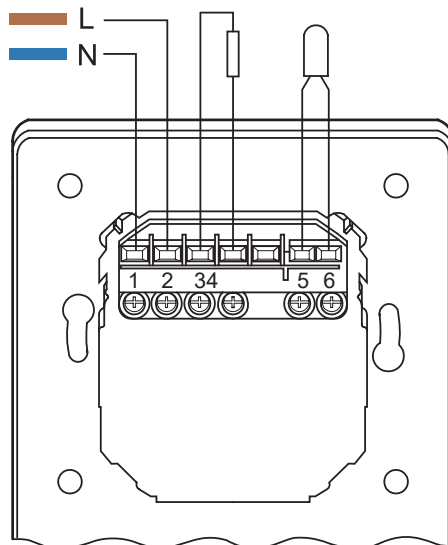


Schlüter®-DITRA-HEAT-E-R /-R4

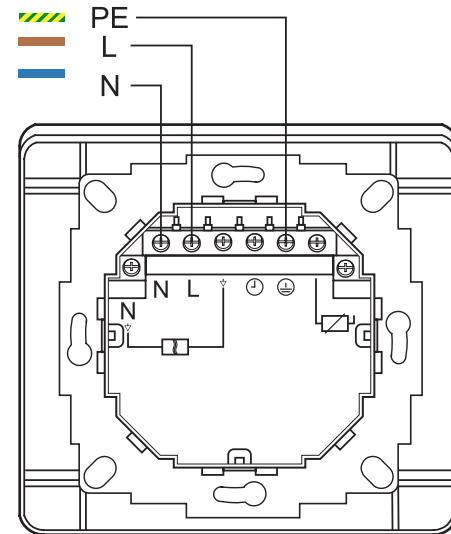

Important: Testing of the heating cable must be carried out prior to installation, and again after installation of the heating cable and before tile/stone floor finish is installed. To test the resistance of the heating cable use the Schlüter®-DITRA-HEAT-E-CT cable tester with inbuilt alarm. See below for Ohm* figures for each cable length (Art. No.).

Note: The two heating cables that should be connected to the Live/Neutral are the two insulated cables (shown in the photo on the right), the bare cable is the earth. Please note it does not matter which way around the heating core cables (insulated) are connected to the thermostat. Either cable can be connected to the Live/Neutral connection on the thermostat, shown above.





Resistance test table


L = m	Heated area in m ² 136 W/m ²	Heated area in m ² 200 W/m ²	Watt	Art.-No.	Amps	Total Ohm*
4.0	0.4	0.25	50	DH E HK 4	0.22 amps	1058.00
6.76	0.6	0.43	85	DH E HK 6	0.37 amps	626.00
12.07	1.1	0.7	150	DH E HK 12	0.65 amps	352.67
17.66	1.6	1.0	225	DH E HK 17	0.97 amps	235.11
23.77	2.2	1.5	300	DH E HK 23	1.30 amps	176.33
29.87	2.7	1.8	375	DH E HK 29	1.63 amps	141.07
35.97	3.3	2.2	450	DH E HK 35	1.95 amps	117.56
41.56	3.8	2.6	525	DH E HK 41	2.28 amps	100.76
47.67	4.4	2.9	600	DH E HK 47	2.60 amps	88.17
53.77	5.0	3.3	675	DH E HK 53	2.93 amps	78.37
59.87	5.5	3.7	750	DH E HK 59	3.26 amps	70.53
71.57	6.6	4.4	900	DH E HK 71	3.91 amps	58.78
83.77	7.7	5.1	1050	DH E HK 83	4.56 amps	50.38
95.47	8.8	5.9	1200	DH E HK 95	5.21 amps	44.08
107.67	10.0	6.6	1350	DH E HK 107	5.86 amps	39.19
136.00	12.7	8.4	1700	DH E HK 136	7.39 amps	31.12
164.00	15.0	10.0	2050	DH E HK 164	8.91 amps	25.80
192.00	17.7	11.8	2400	DH E HK192	10.43 amps	22.04
216.00	20.0	13.2	2700	DH E HK 216	11.74 amps	19.59
244.00	22.7	15.1	3050	DH E HK 244	13.26 amps	17.34

* Resistor tolerance -5% / +10%



Installation instructions

Please read these instructions carefully before starting the installation work.

 The electrical connection must be implemented by a qualified electrician, according to the relevant wiring diagram indicated and in compliance with all applicable safety regulations. The electrical wiring must conform to BS 7671: "The IEE Wiring Regulations" (latest edition)

Important installation information

- When installing, observe the general regulations of technology and valid standards from the DIN VDE 0100 series and the TAB, specifically DIN VDE 0100-753 (constructor specifications), 0100-701 (requirements of rooms with baths or showers) 0100-520 (cable and cable systems).
- In addition to these installation instructions, observe the corresponding 6.4 Schlüter®-DITRA-HEAT product data sheet and the installation instructions included with the controller.
- The extent of delivery and accessories must be checked for accordance with planning.
- When installing on level ground or in unheated rooms, thermal insulation must be installed to ensure effective heating of the floor.
- Schlüter®-DITRA-HEAT DUO should not be installed directly above an insulation board with a foam core
- Schlüter®-DITRA-HEAT must not be laid on easily flammable construction materials in accordance with DIN 4102-4.
- The substrate must have no adhesion-resistant components, must be capable of bearing weight and must be level. Any necessary levelling measures must be carried out before laying the Schlüter®-DITRA-HEAT.
- Selection of the adhesive for processing the

Schlüter®-DITRA-HEAT is according to the type of substrate. The adhesive must adhere to the substrate and must mechanically lock into the support fleece of the Schlüter®-DITRAHEAT.

- With most substrates, a hydraulically setting thin-bed adhesive can be used. Any material incompatibilities must be assessed.
- Thin-bed adhesive for filling the Schlüter®-DITRA-HEAT must be suitable for the floor heating.
- Heating cables must not be kinked.
- Heating cables must not touch or cross, and must maintain a minimum distance to each other.
- Heating cables must not be installed over expansion joints or dummy joints.
- Heating cables must only be shortened on the cold conductor side.
- During installation, ensure protection against indirect touching of an RCD (FI circuit breaker) with an error trigger current of ($\Delta I_N \leq 30 \text{ mA}$).
- The heating cables must not be installed at temperatures below 5 °C.
- The heating cables and connection box must be installed so that the cold conductors or PE protective conductors can be routed to the connection boxes without extension.
- Sleeves (cold-hot transitions) must not be kinked.
- A warning symbol for installation of the heating cables must be attached near to the electrical distribution in addition to the configuration (installation plan) of the heating cables.
- The heating cables must be installed at a minimum of 30 mm distance to conductive parts of the buildings (e.g. water conduits).
- Heating cables and cable sleeves must be completely embedded into the tile adhesive.

Connections

- Connection cables must be routed in a plastic armoured conduit with minimum wall thickness of 0.8 mm. Sensors and heating cables should not be routed through the same conduit, install a separate conduit for each.
- If more than one heating circuit is installed, all connection cables must be routed through the empty conduit into the control box or flush-mounted box and connected via the supplied system connection. Cold conductors and protective conductors must not touch or cross the heating conductor.
- Heating circuits, also of varying dimensions, can be switched via a common system connection without problems. Observe the maximum current of the controller.

Further information

- When installing the heating conductors in baths and showers, leave room for areas intended for installing sanitary facilities such as baths, showers, floorstanding WCs, floor-standing bidets and fitted furniture (observe the DIN VDE 0100 series).
- Heating cables and controllers are not intended to be used by people (including children) with limited physical, sensory or mental ability or insufficient experience and/or insufficient knowledge, unless they are supervised by a person responsible for their safety or have been given instructions in the use of these devices. Children should be supervised to ensure that they do not play with the devices.
- Heating cables must be separated from other heat sources such as lighting equipment and chimneys.
- The smallest permissible bending radius is the 5-fold outside diameter of the heating cable.



- Heating cables may only be stepped on to a maximum of the extent required for installation. Ensure you wear suitable shoes with rubber soles.
- Cabinets with full-surface installation and built-in cupboards may only be positioned on or in front of unheated surfaces.
- In areas where heating cables have been installed, no penetrative fixing components (dowelled screws for door stoppers, towel rails etc.) may be installed.
- Supplementary covers for the heated floor or wall covering (thickness ≥ 10 mm) or pictures are not permissible as these cause heat congestion and may therefore damage the heating cables.
- The heating cables must be completely surrounded by the tile adhesive to avoid air gaps.

Application range

Schlüter®-DITRA-HEAT is a dimensionally stable polypropylene foil with a singlesided, special stud structure for accommodating the heating cables of the system. The foil underside has a fleece for anchoring into the tile adhesive. The system can be installed either as floor or wall heating directly below the ceramic or natural stone covering. Both floor and wall heating serve as supplementary comfort heating, and can also be used as full heating (heat requirements should be taken into account). Due to the low mounting height of DITRA-HEAT, this heating system is especially suitable for the renovation of bathrooms, showers, kitchens etc. Covering thicknesses > 30 mm are not recommended due to heat factors.

Information about installing DITRA-HEAT in wall areas:

For more suitable designation of the wall area heating (to prevent unintended drilling into the heating cable) we recommend visually emphasising this area with the aid of Schlüter profiles (e.g. RONDEC, QUADEC or DESIGNLINE). With heated wall surfaces ≥ 3 m, wall or connection joints must be implemented in a permanently elastic way due to thermal modifications to length. Sealing the Schlüter®-DITRA-HEAT, visual limitation of the heated wall surface and permissible substrates are specified in data sheet 6.4


Processing

Electrical installation must only be implemented by an authorised electrician (EN 60335-1). This heating cable must be equipped with an all-pole disconnecting device from the mains with a contact opening of at least 3mm per pole. Ensure protection against indirect touching with an RCD (FI circuit breaker) with an error trigger current of $I_{\Delta N} \leq 30$ mA.

General

③ **Variant A:** The floor sensors are positioned directly into the freshly laid Schlüter®-DITRA-HEAT decoupling underlay. Because the floor sensor is embedded directly into the thin-bed adhesive and cannot be subsequently replaced, a reserve sensor must be provided during installation. The sensors must be laid centrally between two heating cable loops.

Variant B: For removal/replacement of the sensor. The floor sensor of the temperature controller is positioned in the protective conduit with sensor sleeve directly in the floor under the Schlüter®-DITRA-HEAT decoupling underlay. The sensor is routed through the protective conduit and the sleeve is then fitted over. (The protective conduit and sensor sleeve are available, Art-No. DH E ZS 1) To ensure an optimal temperature transition from the surface to be heated to the sensor, no insulating material must exist between the sensor sleeve and the DITRA-HEAT. In such cases, insulation must omitted in the sensor sleeve area.

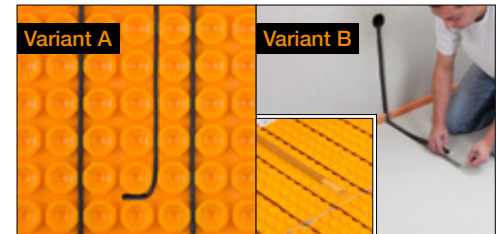

Note: Prior to embedding the sensor with thin-bed adhesive, the resistance values must be measured and compared with the values specified in the controller instructions.




Installation instructions

General

2 Protective zones in accordance with VDE 0100-701.


Positioning the controller is not permissible in the B0, B1 and B2 areas.

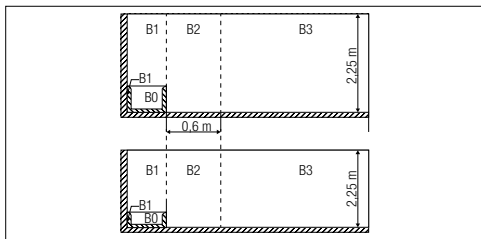

Positioning the floor sensor

- 3 a) Schlüter®-DITRA-HEAT-E
- b) Floor sensor and reserve sensor
- c) Floor temperature controller

With a combination of floor and wall heating with only one controller, the floor sensor and reserve sensor must be positioned in the floor area (Fig. b). With wall heating only, both sensors are positioned in the wall area (Fig. c).

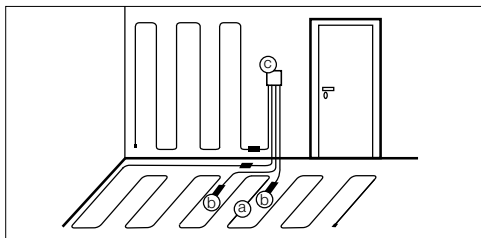

- 4 A suitable thin-bed adhesive is applied to the substrate with a notched trowel (6 x 6 mm). To achieve improved initial bonding adhesion in wall areas, we recommend applying a contact layer on the rear of the Schlüter®-DITRA-HEAT.



-HEAT or to prevent separation from the substrate, we recommend protecting these from mechanical overloads e.g. by use of running boards (mainly in the running centre for material transport).



- 5 The Schlüter®-DITRA-HEAT, previously cut to fit, is completely embedded with the support fleece into the applied adhesive and immediately pressed into the adhesive in the direction of working with the aid of a float or pressure roller. The time for adhesion must be observed. When laying rolled material, it is useful to precisely align the Schlüter®-DITRA-HEAT during laying and to apply it stretched tightly under light pressure.

⚠ An additional person is useful for easier installation.

Due to restoring forces with rolled materials, we recommend using mats for installing Schlüter®-DITRA-HEAT in wall areas.


The mats or strips are laid back-to-back.

- To prevent damage to the installed Schlüter®-DITRA

Installing the heating cables

- 6 **Image A:** With installation in floor areas, the heating cables can be laid with a plasterer's float immediately after bonding the DITRA-HEAT uncoupling underlay. With installation in wall areas, heating cables are laid after a sufficient adhesive connection is established.

Image B: Provide a corresponding indentation in the area of the welded wire end. Heating cables must not touch or cross each other.

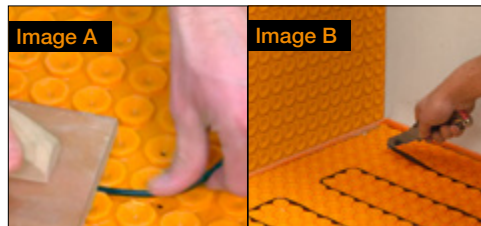




In floor areas

- 7 Stud distances on the uncoupling underlay are 3cm. The installation distance of the heating cables in floor areas consists of 9 cm (each third nap – corresponding to 136 W/m²). Cables must not be installed tighter than this. Smaller distances, especially in floor areas, may cause overheating and damage to the building substance. During installation work, ensure that heating cables are not directly stepped on.


In wall areas

- 7 Installation distances in wall areas can be selected according to the surface available, the desired surface temperature and the required heat output, between
6 cm (each 2nd stud - corresponding to 200 W/m²)
9 cm (each 3rd stud - corresponding to 136 W/m²)

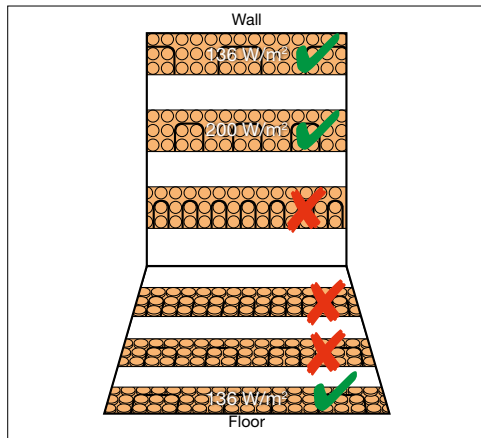

- 8 The transition in the heating cable from the heating conductor side to the cold conductor side (sleeve) is labelled with an imprint. An „Übergang/Connection“ label is also attached to the sleeve. „KALT/COLD“ is also printed further along the connection cable. This cold conductor (4 m) must be routed directly into a connection box or up to the controller. The cold conductor can be shortened to a max. of 1.00 m in front of the sleeve. Shortening the heating cable is impermissible. Cold conductors must be routed within a protective conduit in the transition zone from the floor to the wall, up until the wall connection box. The cold conductor ends must be connected to the 230 V mains voltage, switched via the controller system. The protective network conductor of the heating cables is connected to the protective conductor of the system. Schlüter heating cables must only be operated with a Schlüter®-DITRA-HEAT-E controller.

Note: Before embedding the heating cables with thin-bed adhesive, an insulation test must be carried out to measure the resistance value of the heating cables. This value must be entered into the provided test protocol.

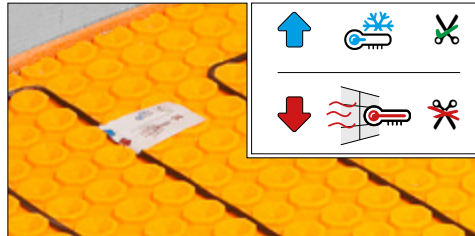

Cold conductor connection

- 9 The cold conductor ends are connected to the wall connection box of the controller according to the diagram.

⚠ Connecting several heating cables is implemented simultaneously. The maximum permissible current on the switching contact of the controller device must be complied with.

L = terminal for switched phase conductor (230 V~) via controller device.

Load connection on the controller.

*cable is insulated

PE = connection terminal shield of cold conductor for wiring protection and FI monitoring.

**cable is not insulated

N = connection terminal neutral conductor of cold conductor

*cable is insulated

After installing and testing the heating cables, the tiles can be laid with a thin-bed adhesive suitable for the requirements of the covering. It is useful to trowel the indentations of the uncoupling underlay with the smooth side of the toothed trowel (heating cables and sleeves must be completely surrounded by tile adhesive) and to comb the thin-bed adhesive with the toothing for laying the tiles, in one work step. The tooth depth of the trowel must be suitable for the tile format for completely embedding into the adhesive. Take into account the open laying time of the thin-bed adhesive. For movement joints as field limitation, edge and connection joints, the corresponding information in the data sheet 6.4 Schlüter®-DITRA-HEAT should be observed.

Installation instructions

Note: The thin-bed adhesive used for the Schlüter®-DITRA-HEAT and the covering material must be suitable for their specific application and comply with the requisite requirements. The first heating up of Schlüter®-DITRA-HEAT-E must be at least 7 days after completion of the covering construction.


Covering the heating cables

DIN VDE / EN regulations (60335-2-96-2002) specify a covering of the heating cables of 5 mm. Permanent temperature resistance of 50 °C must be complied with.

Documentation

The system operator must be given the following documents:


- Laying instruction with completed testing protocol
- Revision plan with position of heating cables, temperature sensor and positioning locations as well as the connection locations of heating and cold conductors
- Description of the floor structure.

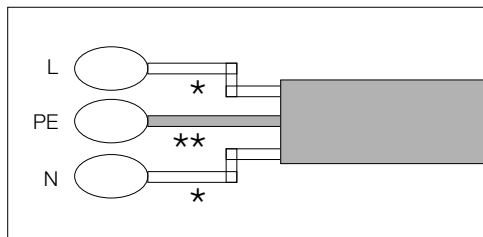

10 Example of floor structure (wall and floor)

1. Screed
2. Schlüter®-DITRA-HEAT
3. Heating cable
4. Temperature-resistant thin-bed adhesive
5. Floor sensor 2x
6. Tiles
7. Connection profile
8. Protective conduit for cold conductor
9. Protective conduit for sensor
10. Temperature controller*
11. Limiting profile (e.g. Schlüter®-QUADEC, RONDEC or DESIGNLINE)

*Controller installation - please consult the instructions included with the controller for further information about installing and setting the controller.

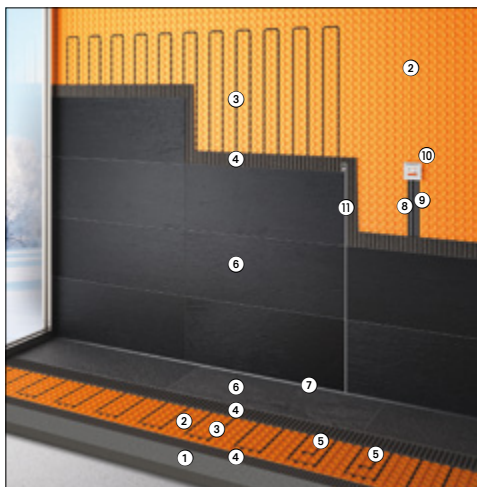



Testing Schlüter®-DITRA-HEAT-E-HK Heating Cables

Testing Procedure

Schlüter®-DITRA-HEAT-E-HK heating cables should be tested before installation. The heating cable must be tested once removed from the box, once installed within the Schlüter®-DITRA-HEAT-E/-DUO membrane, immediately before tiling commences and once tiling is completed. The heating cable should be monitored whilst the floor covering is being installed.

Resistance Test

Using a multimeter, test the resistance between the live and neutral power leads. Record the readings in the back of the installation guide & the following page. The resistance reading should be within -5% / + 10% of the recorded figure. Refer to resistance charts. If the reading is outside this range, the cable may be damaged or the multimeter is on the wrong setting. The test can also be carried out with Schlüter®-DITRA-HEAT-E-CT test device.



Continuity Test Between Earth and Conductors

The conductor cables are separated from the earth cable with an insulator. Each conductor should be tested individually to the earth, the reading should be indicated as 1 on the left side of the display on the multimeter which is measured in ohms.




Insulation Resistance Test

This test would need to be carried out with a Megohmmeter to indicate any small holes in the insulating layer, which separates the conductors from the earth. The Megohmmeter should be set to 500 V DC and if there is no leakage, the insulation resistance between the power leads and earth must be equal to or greater than 1 M ohm or (Infinity). Tests should be carried out between all three cables. If the reading is less than 1 M ohm or 1000 k ohm, there is a short in the insulation layer. Please record the readings on the following page.



Floor Temperature Sensor Testing

Schlüter®-DITRA-HEAT-E-CT should be used to carry out the test on the floor sensors, connect both black clips to each of the sensor cables. The reading on the tester should be that shown on the chart supplied with the DHECT, taking into account the ambient temperature. Both sensors should be tested before installation. Please refer to Art – No. (DH E CT) for further instructions.

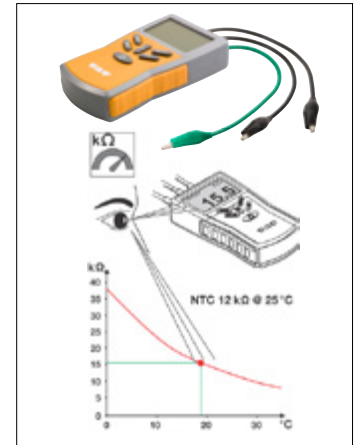

Please Note: If any of the readings are not within the correct tolerances the cable should be replaced.


Please call the Technical Department for further details – tel: +44 (0)1530 813396



Installation Diagram

Please use the space below to illustrate the room layout showing all fixtures & fittings including heating cable and both sensor locations.

Note: It is important that the heating cable is not covered by pedestals, baths, showers, kitchen units & rugs etc.

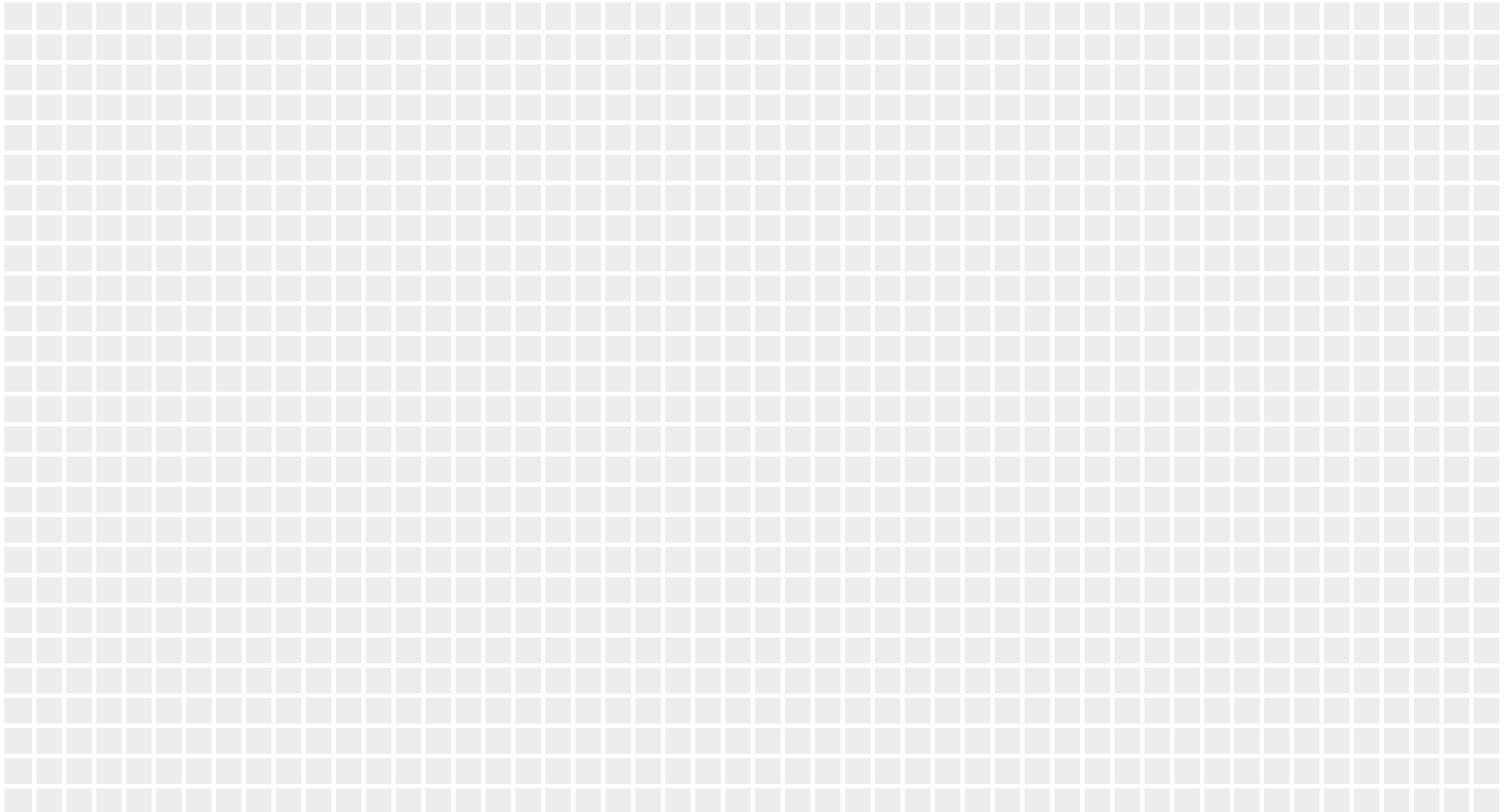

Photo(s) of Installation

Please include below photo(s) of entire floor area, including sensors and the hot/cold transition label.



Certified Installer





Heating Cable Test Log

Project Name: _____

Project Address: _____

Project Postcode: _____ Date of Installation: _____

Qualified Electrician: _____ System Start Up Date*: _____

Thermostat

- Schlüter®-DITRA-HEAT-E-R - Art.-No. DH E RT2 / BW
- Schlüter®-DITRA-HEAT-E-R3 - Art.-No. DH E RT3 / BW
- Schlüter®-DITRA-HEAT-E-R4 - Art.-No. DH E RT4 / BW
- Schlüter®-DITRA-HEAT-E-R-WIFI - Art.-No. DH E RT5 / BW

Date of start up, incl. function test: _____

Entering a date confirms the proper function of the installed Schlüter®-DITRA-HEAT-E, including the thermostat.

Warranty claims must be supported with the fully completed testing and start up log, together with a sketch, drawing or image(s) of the cable layout prior to tiling. Supporting information must show overall heating cable layout with location of floor sensors and hot/cold cable connection in floor or wall.

Important note!

The warranty does not cover consequential damage resulting from installations that do not comply with the installation instructions for Schlüter®-DITRA-HEAT-E or the operating and installation instructions of the floor thermostat. Please keep purchase records on file.

Disposal notice

This product may not be disposed of with household waste.

Technical specifications subject to change.





Heating Cable Schlüter®-DITRA-HEAT-E-HK

Identification	Factory Value	Before Installation	After Cable Installation	After Tile Installation
Test 1: Conductor Resistance Test (Readings must fall within -5% / +10% of the factory value indicated in the heating cable chart under total Ohm column.)				
Test 2: Conductor and Continuity Test				
	Infinity (i) or Overload (OL)			
Test 3: Insulation Resistance Test				
	Equal to or greater than 1 Gigaohms**			
Test 4: Thermostat Floor Temperature Sensor Test				
	Temperature	Resistance		
	°C	Kohms		
	10	22.5		
	15	17.5		
	20	15.0		
	25	12.5		
	30	10.0		

* Allow the assembly to cure for 7 days after grouting before turning the system on.

** 1 Gigaohms + 1 G ohms + 1000 M ohms = 1000 Mega ohms.



Information.

If you have any questions about the installation process or any of our products please contact Schlüter Technical Support on Email: technical@schluter.co.uk or Tel: 01530 813396.

Subject to the Standard Terms and Conditions of Sale of Schlüter-Systems Ltd.

All information contained within this document is considered to be true and correct at the date of publication; changes to regulations, standards etc. after the date of publication may impact on the accuracy of the information.

For reasons of printing, colours shown in this price list may differ from actual product colours.



P R O F I L E O F I N N O V A T I O N

Schlüter-Systems Ltd · Units 3-5 Bardon 22 Industrial Estate · Beveridge Lane · Coalville · Leicestershire · LE67 1TE
Tel.: +44 (0) 1530 813396 · Fax: +44 (0) 1530 813376 · technical@schluter.co.uk · sales@schluter.co.uk · www.schluter.co.uk

